

NOTE:

ANY CURB STOP LOCATED IN BLACKTOP OR CONCRETE DRIVEWAY OR SIDEWALK SHALL BE COVERED WITH METER BOX COVER (FORD A-1) OR APPROVED EQUAL.


ALL WATER SERVICES SHALL BE 1" MIN. - TYPE K COPPER. ANY TAP LARGER THAN 1" SHALL USE A SMITH BLAIR STAINLESS STEEL SADDLE TYPE #317 OR #372 OR APPROVED EQUAL.

ALL NEW WATER SERVICES INSTALLED CONNECTING TO EXISTING WATERMAINS SHALL USE AN ALL STAINLESS STEEL SADDLE.

WATER SERVICE MUST BE CONTINUOUS WITH NO JOINTS UNLESS SERVICE IS OVER 100' LONG.

SANITARY AND WATER SERVICE LINES SHALL BE INSTALLED IN THE SAME TRENCH WITH 3 FEET OF SEPERATION.

EXCESSIVE SANITARY SEWER MAIN-LINE DEPTH MUST BE REVIEWED AND APPROVED BY THE ENGINEER.

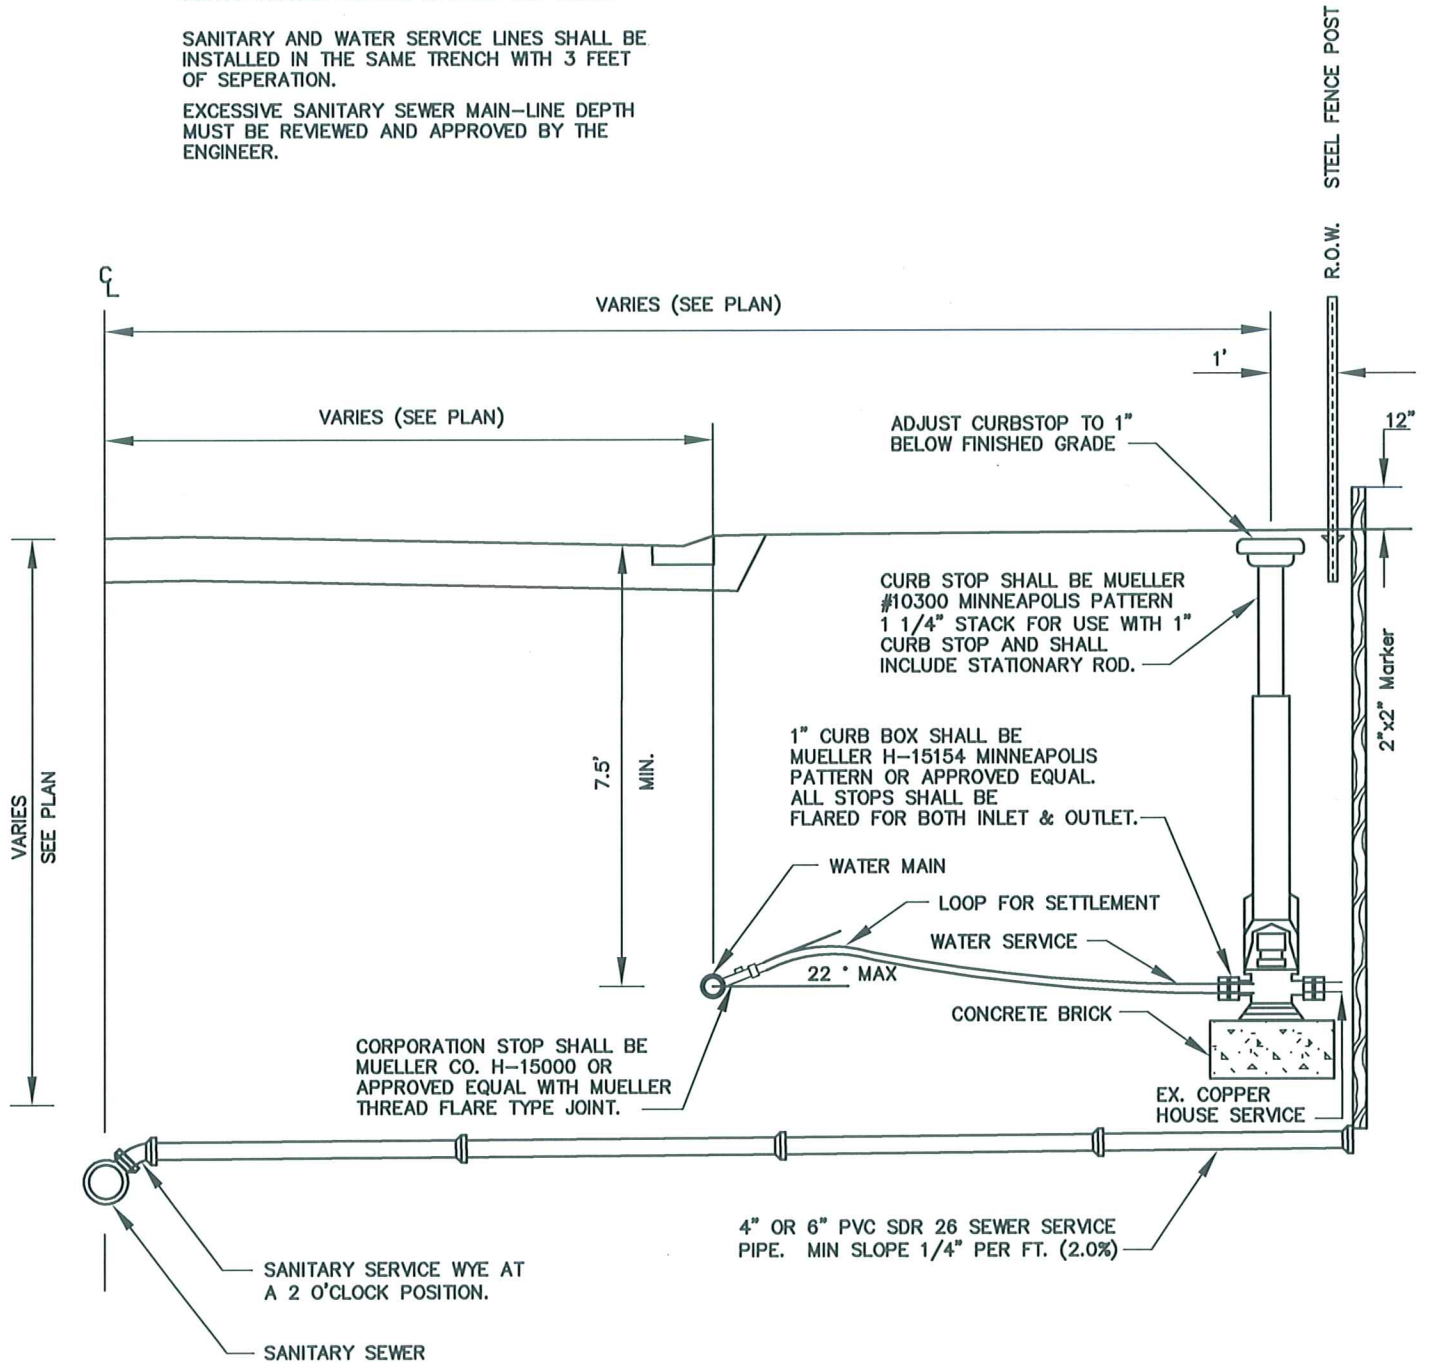

CITY OF EDINA
ENGINEERING
& PUBLIC
WORKS
DEPTS.

SEWER AND WATER SERVICE
CONNECTION

Weyand
APPROVED: CITY ENGINEER

REVISED:
04-09
STANDARD
PLATE
300